

## SPECIFICATIONS

### Input

Voltage Input  
Full Scale Range: 10mV to  $\pm 200\text{mV}$  (Table 1).  
Impedance:  $>1\text{M}\Omega$   
Overvoltage: 400Vrms, max. (intermittent); 264Vrms, max. (continuous).  
Common Mode (Input to Ground): 1800VDC, max.  
Zero Turn-Up: 50% of full scale range  
Span Turn-Down: 50% of full scale range  
Operation: direct or reverse acting

### Output

Voltage Output  
Output: 0-5V, 0-10V  
Impedance:  $<10\Omega$   
Drive: 10mA, max. (1K $\Omega$ , min. @ 10V)  
Current Output  
Output: 0-1mA, 0-20mA, 4-20mA  
Impedance:  $>100\text{K}\Omega$   
Compliance:  
0-1mA; 7.5V, max. (7.5K $\Omega$ , max.)  
0-20mA; 12V, max. (600 $\Omega$ , max.)  
4-20mA; 12V, max. (600 $\Omega$  max.)

### Bridge Excitation

1 to 10VDC, 120mA max.

### Accuracy (Including Linearity, Hysteresis)

$\pm 0.1\%$  typical,  $\pm 0.2\%$  maximum of selected range at 25°C.

### Stability

$\pm 0.025\%/^{\circ}\text{C}$  typical, 0.05%/°C maximum, of selected full scale range.

### Output Noise (maximum)

0.1% of span, rms, or 10mV whichever is greater.

### Response Time (10 to 90%)

$<200\text{mSec.}$ , typical.

### Common Mode Rejection

DC to 60Hz:  $\geq 120\text{dB}$   
 $\geq 100\text{dB}$  (0-1mA, range)

### Isolation

1800VDC between input, output and power.

### EMC Compliance

Emmissions: EN50081-1  
Immunity: EN50082-2  
Safety: EN50178

### LED Indication (green)

Input Range (approx.)  
 $>110\%$  input: 8Hz flash  
 $<0\%$  input: 4Hz flash

### Humidity (Non-Condensing)

Operating: 15 to 95% (@ 45°C)  
Soak: 90% for 24 hours (@ 65°C)

### Temperature Range<sup>1</sup>

Operating: 0 to 55°C (32 to 131°F)

Storage: -25 to 70°C  
(-13 to 158°F)

### Power

Consumption: 1.5W typical, 2.5W max. (one 350 $\Omega$  bridge), 4W max. (four 350 $\Omega$  bridges).

Range: 18 to 30VDC

### Wire Terminations

Screw terminals for 12-22 AWG

### Mounting:

32mm or 35mm DIN Rail

### Agency Approvals

CSA certified per standard C22.2, No. 0-M91 and 142-M1987 (File No. LR42272) UL recognized per standard UL508 (File No. E99775). CE Conformance per EMC directive 89/336/EEC and low voltage 73/23/EEC.

### PIN CONNECTIONS

11 DC Power (+)  
12 DC Power (-)  
13 No Internal Connection  
21 DC Power (+)  
22 DC Power (-)  
23 No Internal Connection  
41 Bridge Input (+)  
42 Bridge Input (-)  
43 Excitation (+)  
51 Output (+)  
52 Output (-)  
53 Excitation (-)



## DRG-SC-BG

## Bridge Input, Field Configurable Signal Conditioner

Instruction Sheet M2390/0796

### DESCRIPTION

The DRG-SC-BG is a DIN rail mount, bridge or strain-gage input signal conditioner with 1800VDC isolation between input, output and power. The field configurable input and output offers flexible, wide ranging capability for bridge or strain-gage input applications from 0.5mV/V to over 50mV/V.

Wide ranging, precision zero and span pots allow 50% adjustability of offset and gain within each of the 11 switch selectable input ranges. The output can be set for either 0-5V, 0-10V, 0-1mA, 0-20mA or 4-20mA.

This flexibility, combined with an adjustable (1 to 10VDC) bridge excitation source, provides the user a reliable, accurate instrument to isolate and condition virtually any bridge or strain-gage input.

### APPLICATION

The DRG-SC-BG field configurable, bridge input signal conditioner is useful in isolating ground loops and interfacing bridge sensors to data acquisition and control systems.

Three way isolation completely eliminates ground loops from any source. Isolation protects expensive SCADA systems from ground faults and provides filtering for noise reduction which can be a significant problem with small, millivolt, bridge signals.

Wide ranging flexibility allows the user to easily zero out dead-loads in weighing systems or configure bipolar input ranges for expansion-compression or vacuum-pressure bridge applications.

High density DIN rail mounting offers an extremely compact solution for saving valuable panel space.

### DIAGNOSTIC LEDES

The DRG-SC-BG is equipped with a dual function LED signal monitor. The green, front mounted LED indicates both DC power and input signal status. Active DC power is indicated by an illuminated LED. If the input signal is more than 110% of the full-scale range, the LED will flash at 8Hz. If this continues to occur, you may wish to change your full-scale input range setting.

### CONFIGURATION

A major advantage of the DRG-SC-BG is its wide ranging capabilities and ease of configuration. The DRG-SC-BG has 11 input range switch settings. Trim potentiometers allow 50% input zero and span adjustability within each of the 11 full-scale, input ranges.

For example, the 200mV switch setting in Table 1 configures the input for a 0 to 200mV range. Since the span can be contracted by 50%, this enables an input span as narrow as 100mV of the range, or 50%. This span can be positioned anywhere within the 0-200mV range with a zero off-set as large as 50% of the full scale range (e.g. 100 to 200mV input).

Unless otherwise specified, the factory presets the Model DRG-SC-BG as follows:

Input Setting: 0 to 50mV  
Input Range: 0 to 30mV (3mV/V)  
Excitation: 10V  
Operation: Direct  
Output: 4 to 20mA

The DC power input accepts any DC source between 18 and 30V, typically a 24VDC source is used.

For other I/O ranges refer to Tables 1 through 4 and reconfigure switches

SW1 and SW2 for the desired input range, function, excitation and output range.

**WARNING: Do not attempt to change any switch settings with power applied. Severe damage will result!**

### CALIBRATION

1. After configuring the DIP switches, connect the input to a calibrated millivolt source. Connect the output to the actual device load (or a load equivalent to the actual device load value) and apply power. (see Wiring Diagram, Figure 2 or 3).

*NOTE: To maximize thermal stability, final calibration should be performed in the operating installation, allowing approximately 1 to 2 hours for warm up and thermal equilibrium of the system.*

2. Set the calibrator to the desired minimum and adjust the zero potentiometer for the desired minimum output.

3. Set the calibrator to the desired maximum and adjust the span potentiometer for the desired maximum output.

4. Repeat steps 2 and 3, if necessary for best accuracy.



OMEGAnet <sup>SM</sup> On-Line Service <a href="http://www.omega.com">http://www.omega.com</a>	Internet e-mail <a href="mailto:info@omega.com">info@omega.com</a>
---	---

**USA:** One Omega Drive, Box 4047  
Stamford, CT 06907-0047  
Telephone: (203) 359-1660  
e-mail: [info@omega.com](mailto:info@omega.com)  
Fax: (203) 359-7700

**Canada:** 976 Bergar  
Laval (Quebec) H7L 5A1  
Telephone: (514) 856-6928  
e-mail: [canada@omega.com](mailto:canada@omega.com)  
Fax: (514) 856-6886

**USA and Canada:** Sales Service: 1-800-826-6342 / 1-800-TC-OMEGA<sup>SM</sup>  
Customer Service: 1-800-622-2378 / 1-800-622-BEST<sup>SM</sup>  
Engineering Service: 1-800-872-9436 / 1-800-USA-WHEN<sup>SM</sup>  
TELEX: 996404 EASYLINK; 62968934 CABLE: OMEGA

**Mexico and Latin America:** Tel: (95) 800-TC-OMEGA<sup>SM</sup> Fax: (95) 203-359-7807  
En Espanol: (203) 359-1660 ext. 2203 e-mail: [espanol@omega.com](mailto:espanol@omega.com)

**Benelux:** Postbus 8034, 1180 LA Amstelveen, The Netherlands  
Tel: (31) 20 6418405 Fax: (31) 20 6434643  
Toll Free in Benelux: 06 0993344  
e-mail: [nl@omega.com](mailto:nl@omega.com)

**Czech Republic:** Ostravska 767, 733 01 Karvina  
Tel: 42 (69) 6311899 Fax: 42 (69) 6311114  
e-mail: [czech@omega.com](mailto:czech@omega.com)

**France:** 9, rue Denis Papin, 78190 Trappes  
Tel: 33 01 30-621-400 Fax: 33 01 30-699-120  
Toll Free in France: 05-4-06342  
e-mail: [france@omega.com](mailto:france@omega.com)

**Germany/Austria:** Daimlerstrasse 26, D-75392 Deckenpfronn, Germany  
Tel: 49 (07056) 3017 Fax: 49 (07056) 8540  
Toll Free in Germany: 0130 11 21 66  
e-mail: [germany@omega.com](mailto:germany@omega.com)

**United Kingdom:** 25 Swanington Road, P.O. Box 7, Omega Drive  
Broughton Astley, Leicestershire, Irlam, Manchester,  
LE9 6TU, England M44 5EX, England  
Tel: 44 (1455) 285520 Tel: 44 (161) 777-6611  
Fax: 44 (1455) 283912 Fax: 44 (161) 777-6622



### WARRANTY/DISCLAIMER

OMEGA ENGINEERING, INC. warrants this unit to be free of manufacturing defects for the life of the product. If the unit should malfunction, it must be returned to the factory for evaluation. OMEGA's Customer Service Department will issue an Authorized Return (AR) number immediately upon phone or written request. Upon examination by OMEGA, if the unit is found to be defective it will be repaired or replaced at no charge. OMEGA's WARRANTY does not apply to defects resulting from any action of the purchaser, including but not limited to mishandling, improper interfacing, operation outside of design limits, improper repair, or unauthorized modification. This WARRANTY is VOID if the unit shows evidence of having been tampered with or shows evidence of being damaged as a result of excessive corrosion; or current, heat, moisture or vibration; improper specification; misapplication; misuse or other operating conditions outside of OMEGA's control. Components which wear are not warranted, including but not limited to contact points, fuses, and triacs.

OMEGA is pleased to offer suggestions on the use of its various products. However, OMEGA neither assumes responsibility for any omissions or errors nor assumes liability for any damages that result from the use of its products in accordance with information provided by OMEGA, either verbal or written. OMEGA warrants only that the parts manufactured by it will be as specified and free of defects. OMEGA MAKES NO OTHER WARRANTIES OR REPRESENTATIONS OF ANY KIND WHATSOEVER, EXPRESSED OR IMPLIED, EXCEPT THAT OF TITLE, AND ALL IMPLIED WARRANTIES INCLUDING ANY WARRANTY OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED. LIMITATION OF LIABILITY: The remedies of purchaser set forth herein are exclusive and the total liability of OMEGA with respect to this order, whether based on contract, warranty, negligence, indemnification, strict liability or otherwise, shall not exceed the purchase price of the component upon which liability is based. In no event shall OMEGA be liable for consequential, incidental or special damages.

CONDITIONS: Equipment sold by OMEGA is not intended to be used, nor shall it be used: (1) as a "Basic Component" under 10 CFR 21 (NRC), used in or with any nuclear installation or activity; or (2) in medical applications or used on humans. Should any Product(s) be used in or with any nuclear installation or activity, medical application, used on humans, or misused in any way, OMEGA assumes no responsibility as set forth in our basic WARRANTY/DISCLAIMER language, and additionally, purchaser will indemnify OMEGA and hold OMEGA harmless from any liability or damage whatsoever arising out of the use of the Product(s) in such a manner.

### RETURN REQUEST/INQUIRIES

Direct all warranty and repair requests/inquiries to the OMEGA Customer Service Department. BEFORE RETURNING ANY PRODUCT(S) TO OMEGA, PURCHASER MUST OBTAIN AN AUTHORIZED RETURN (AR) NUMBER FROM OMEGA'S CUSTOMER SERVICE DEPARTMENT (IN ORDER TO AVOID PROCESSING DELAYS). The assigned AR number should then be marked on the outside of the return package and on any correspondence. The purchaser is responsible for shipping charges, freight, insurance and proper packaging to prevent breakage in transit.

FOR **WARRANTY** RETURNS, please have the following information available BEFORE contacting OMEGA:

1. P.O. number under which the product was PURCHASED,
2. Model and serial number of the product under warranty, and
3. Repair instructions and/or specific problems relative to the product

FOR **NON-WARRANTY** REPAIRS, consult OMEGA for current repair charges. Have the following information available BEFORE contacting OMEGA:

1. P.O. number to cover the COST of the repair,
2. Model and serial number of product, and
3. Repair instructions and/or specific problems relative to the product.

OMEGA's policy is to make running changes, not model changes, whenever an improvement is possible. This affords our customers the latest in technology and engineering.

OMEGA is a registered trademark of OMEGA ENGINEERING, INC. a Copyright 1996 OMEGA ENGINEERING, INC. All rights reserved. This documentation may not be copied, photocopied, reproduced, translated, or reduced to any electronic medium or machine-readable form, in whole or in part, without prior written consent of OMEGA ENGINEERING, INC.

It is the policy of OMEGA to comply with all worldwide safety and EMC/EMI regulations that apply. OMEGA is constantly pursuing certification of its products to the European New Approach Directives. OMEGA will add the CE mark to every appropriate device upon certification. The information contained in this document is believed to be correct but OMEGA Engineering, Inc. accepts no liability for any errors it contains, and reserves the right to alter specifications without notice.

WARNING: These product are not designed for use in, and should not be used for, patient connected applications.

**Table 1: Input Range Selector-Switch Settings**

	SW1				
	1	2	3	4	5
0 to 10mV	■	■	■	■	■
0 to 20mV	■	■	■	■	■
0 to 50mV	■	■	■	■	■
0 to 100mV	■	■	■	■	■
0 to 200mV	■	■	■	■	■
-5 to 5mV	■	■	■	■	■
-10 to 10mV	■	■	■	■	■
-20 to 20mV	■	■	■	■	■
-50 to 50mV	■	■	■	■	■
-100 to 100mV	■	■	■	■	■
-200 to 200mV	■	■	■	■	■

KEY ■ = ON

**Table 2: Direct or Reverse Operation Setting**

	SW1
	6
DIRECT	■
REVERSE	■


**Table 3: Bridge Excitation Selector-Switch Settings**

	SW1	
	7	8
9.8 to 10.1V	■	■
4.8 to 5.2V	■	■
0 to 10V	■	■
0 to 2.5V	■	■


**Table 4: Output Range Selector-Switch Settings**

	SW 2							
	1	2	3	4	5	6	7	8
0 to 5V	■	■	■	■	■	■	■	■
0 to 10V	■	■	■	■	■	■	■	■
0 to 1mA	■	■	■	■	■	■	■	■
4 to 20mA	■	■	■	■	■	■	■	■
0 to 20mA	■	■	■	■	■	■	■	■



KEY ■ = ON

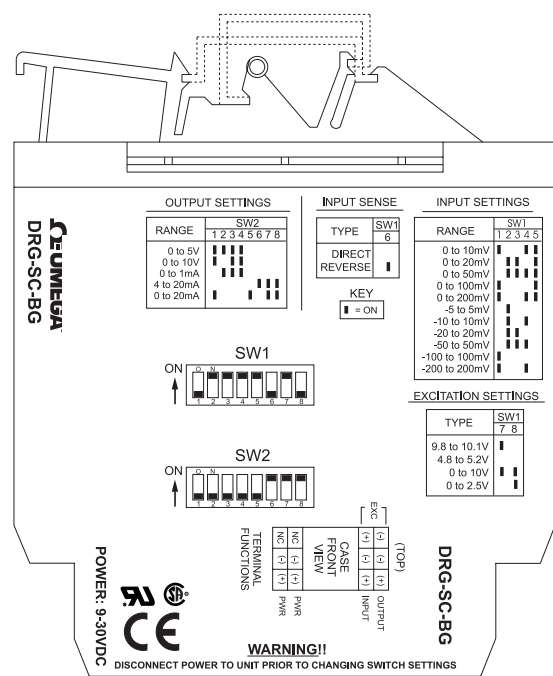


**Figure 1: DRG-SC-BG Factory Calibration; 0 to 30mV (0 -50mV switch settings) 10V excitation, direct operation, 4-20mA output**

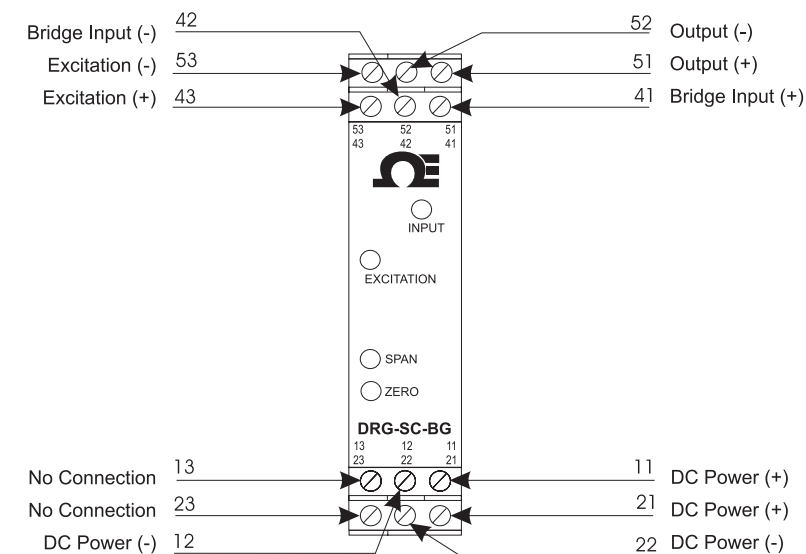

**Figure 2: Wiring Diagram for DRG-SC-BG**

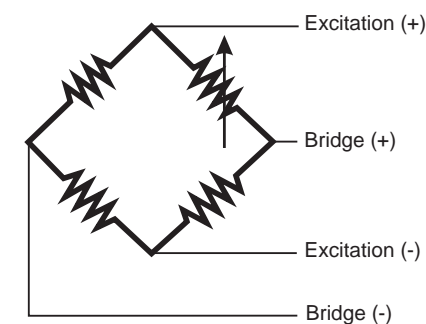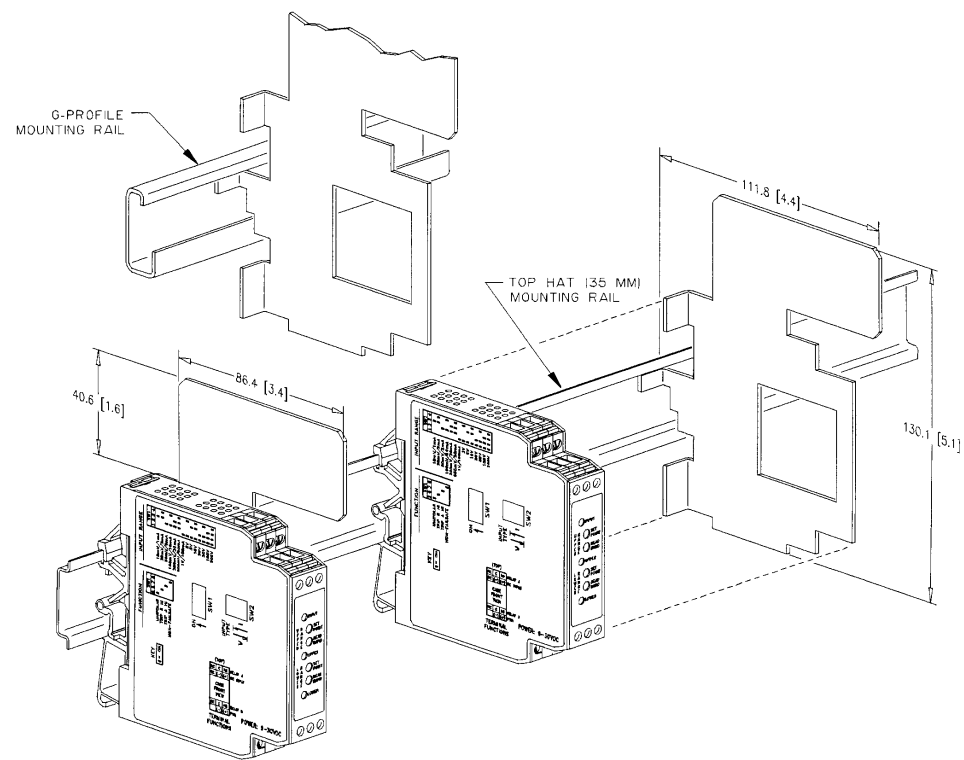

Note1: All DRG Series modules are designed and tested to operate in ambient temperatures from 0 to 55°C, when mounted on a horizontal DIN rail. When five or more modules are mounted on a vertical rail, circulating air or model DRG-HS01 Heat Sink is recommended. Please refer to DRG-HS01 Technical Bulletin or contact factory for assistance.

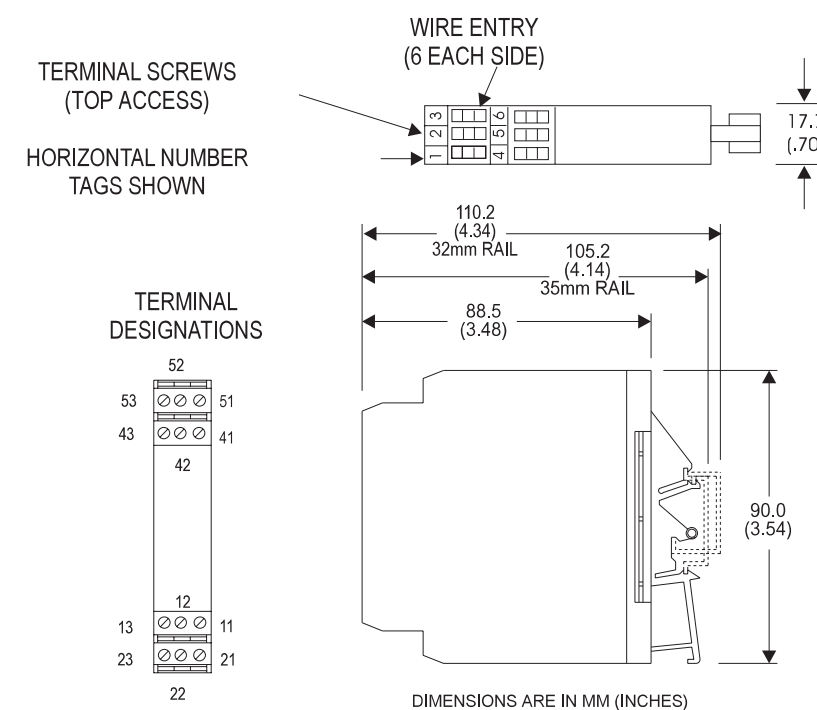

**Figure 4: Mechanical Dimensions for DRG-SC-BG**

**Figure 3: Bridge Reference Designations**