



Ω OMEGA™ **User's Guide**



***Shop online at
omega.com***

***e-mail: info@omega.com
For latest product manuals:
omega.com/en-us/pdf-manuals***

PTC-16-A Multifunction Digital Timer



omega.com info@omega.com

Servicing North America:

U.S.A.

Headquarters:

Omega Engineering, Inc.

800 Connecticut Ave. Suite 5N01, Norwalk, CT 06854

Toll-Free: 1-800-826-6342 (USA & Canada only)

Customer Service: 1-800-622-2378 (USA & Canada only)

Engineering Service: 1-800-872-9436 (USA & Canada only)

Tel: (203) 359-1660

Fax: (203) 359-7700

e-mail: info@omega.com

For Other Locations Visit omega.com/worldwide



Please read this document carefully before using this product. The product guarantee will become invalidated by any damage to the timer caused by not following the instructions in the user manual. Omega do not accept any liability for personal injury, material damage or capital losses which may arise by not following the instructions in the user manual.

- 4 digit backlit LCD display digital timer
- 24 programmable timing modes
- 0-9999sec or 0-9999min time ranges
- 24 to 240Vac/dc powered
- 1 changeover and 1 N/O relay output
- Easy to programme through front keys
- Status and timing indicators
- EEPROM memory (minimum 10 years)
- IP20 enclosure code
- DIN rail mounting
- 2 module 36mm width
- Clear hinged tamperproof cover



CE **RoHS**
Compliant

TECHNICAL SPECIFICATION

ENVIRONMENTAL CONDITIONS

Operating/Storage Temperature: -5°C to +45°C / -10°C to +55°C
Protection Class: IP20
Installation Height: Maximum 2000m

! Do not use this timer in locations where corrosive or flammable gases could be present.

ELECTRICAL

Power Supply Voltage: 24 to 240Vac/dc
Power Consumption (Burden): <3VA
Frequency: 50/60Hz
Wiring: 2mm² screw type terminals
Data Retention: EEPROM (minimum 10 years)
CE Markings: EN 60947-5-1:2004+A1:2009, EN 60730-1:2012,
EN 60730-2-7:2011+AC:2012, EN 61000-6-2:2005,
EN 61000-6-4:2007+A1:2011, EN 61000-3-2:2014, EN 61000-3-3:2013

OUTPUTS


Relay Outputs (R1 & R2): R1: Single pole changeover contact 8A rated at 240Vac (resistive load)
R2: Single pole N/O contact 8A rated at 240Vac (resistive load)
Relay Contact Life: Mechanical 1,000,000 operations
Electrical 100,000 operations
Reset Time: 100ms approx.
Accuracy: ±3sec/24hours

HOUSING


Housing Type: DIN rail mounting 2 module width
Display: Backlit LCD display
Dimensions: 36mm wide x 90mm high x 65mm deep
Weight: Approximately 140g (without packaging)
Enclosure Materials: Self extinguishing plastics

! When cleaning the timer, solvents (thinners, gasoline, acid etc.) or corrosive materials must not be used.

WIRING CONNECTIONS

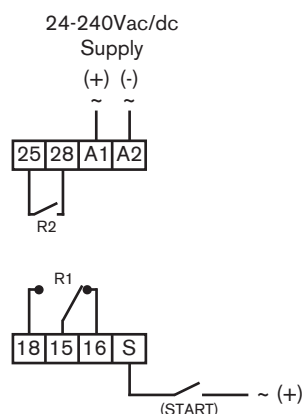

FRONT PANEL DISPLAY FUNCTIONS

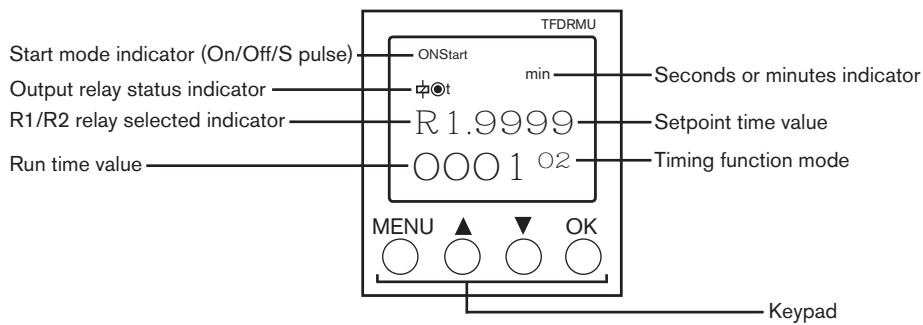


DISPLAY SYMBOLS

	Output Relay ON
	Output Relay OFF
R 1	Output Relay 1
R 2	Output Relay 2
SET	Parameter Setting
ONStart	Starting with ON
OFFStart	Starting with OFF
	Time Impulse release by rising edge
	Time Impulse release by falling edge
min	Set time in minutes
sec	Set time in seconds
T	Time Delay T
T1	Time Delay T1
T2	Time Delay T2
start	Starting with S pulse



KEYS

MENU	<input type="radio"/> Enter configuration menu <input type="radio"/> Exit configuration menu	OK	<input type="radio"/> Confirm settings
	<input type="radio"/> Select menu <input type="radio"/> Digit + <input type="radio"/> Display menu selection		<input type="radio"/> Select menu <input type="radio"/> Digit - <input type="radio"/> Display menu selection

To check the status of R1/R2 output

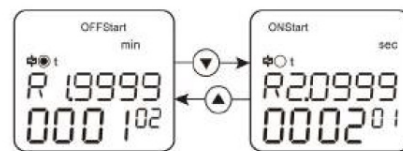


DIMENSIONS

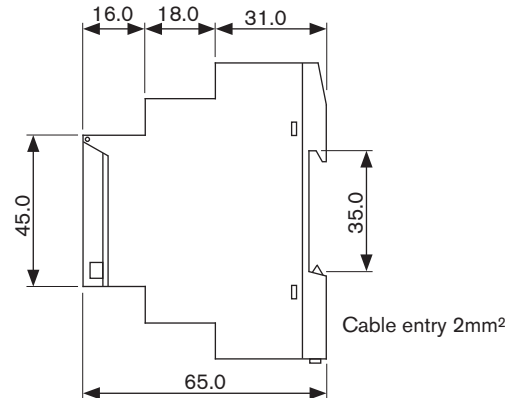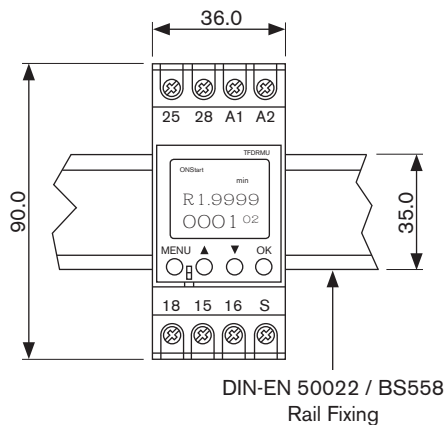

All dimensions in mm


MAIN MENU

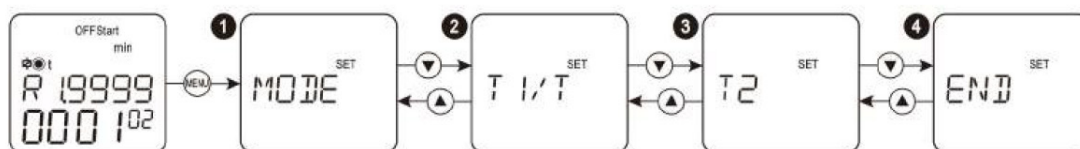

1	MODE	Operating mode adjustment
2	T1/T	T1/T time adjustment
3	T2	T2 time adjustment
4	END	End setting

- Press the MENU key to enter the timer configuration menu, SET will then appear on the display.
- Use the ▲ and ▼ keys to choose the desired sub menu.
- If no key is pressed for 2 minutes the timer will return to the main menu.

OPERATION MODE SETTING

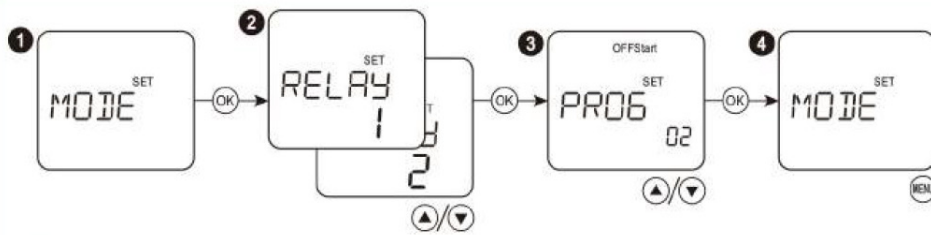


- 1 Select MODE and press the OK key.
- 2 Select output relay 1 or output relay 2 with the ▲▼ keys and press the OK key.
- 3 Choose the desired timing function mode (from 01 to 24, see pages 5-7 for the options) with the ▲▼ keys and press the OK key.
- 4 Return to the main menu by pressing the MENU key.

Note: Press ▲ for longer than 0.5s to increase the numerical value more quickly and press ▼ for longer than 0.5s to decrease the numerical value more quickly.

T1/T TIME DELAY SETTING

- 1 Select the T1/T time setting menu and press the OK key.
- 2 Select output relay 1 or output relay 2 with the ▲▼ keys and press the OK key.
- 3 If a time in seconds (up to 9999 seconds) is required select SEC with the ▲▼ keys and press the OK key.
- 4 Choose the required thousands of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 5 Choose the required hundreds of seconds (0 to 9) with the ▲▼ keys and press the OK key.

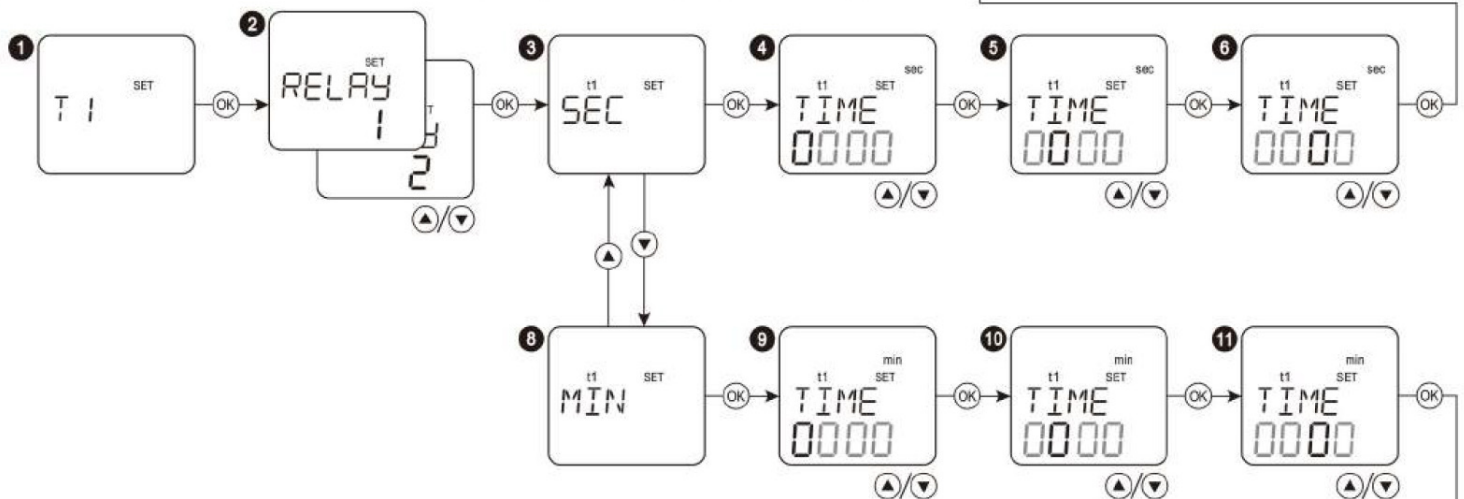


- 6 Choose the required tens of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 7 Choose the required units of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 8 If a time in minutes (up to 9999 minutes) is required select MIN with the ▲▼ keys and press the OK key.
- 9 Choose the required thousands of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 10 Choose the required hundreds of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 11 Choose the required tens of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 12 Choose the required units of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 13 Return to the main menu by pressing the MENU key.

Note: Press ▲ for longer than 0.5s to increase the numerical value more quickly and press ▼ for longer than 0.5s to decrease the numerical value more quickly.

T2 TIME DELAY SETTING

- 1 Select the T2 time setting menu and press the OK key.
- 2 Select output relay 1 or output relay 2 with the ▲▼ keys and press the OK key.
- 3 If a time in seconds (up to 9999 seconds) is required select SEC with the ▲▼ keys and press the OK key.
- 4 Choose the required thousands of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 5 Choose the required hundreds of seconds (0 to 9) with the ▲▼ keys and press the OK key.

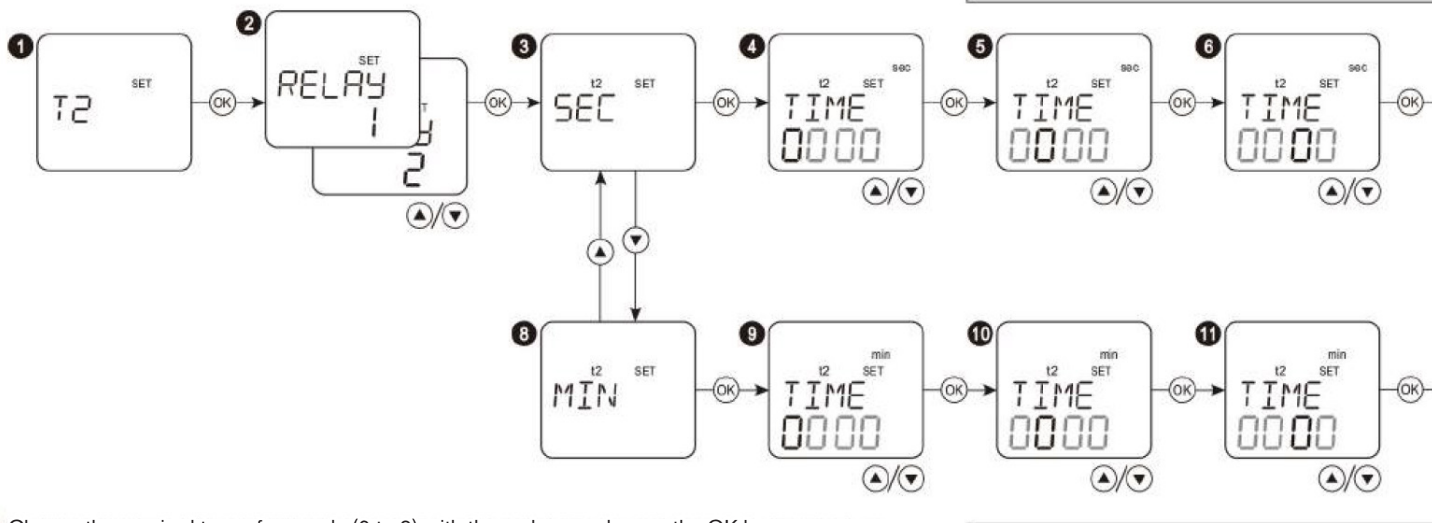

- 6 Choose the required tens of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 7 Choose the required units of seconds (0 to 9) with the ▲▼ keys and press the OK key.
- 8 If a time in minutes (up to 9999 minutes) is required select MIN with the ▲▼ keys and press the OK key.
- 9 Choose the required thousands of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 10 Choose the required hundreds of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 11 Choose the required tens of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 12 Choose the required units of minutes (0 to 9) with the ▲▼ keys and press the OK key.
- 13 Return to the main menu by pressing the MENU key.

Note: Press ▲ for longer than 0.5s to increase the numerical value more quickly and press ▼ for longer than 0.5s to decrease the numerical value more quickly.

TIMING FUNCTION MODES

01 Delay on Energise (On Delay)



The time period T starts when the supply voltage is applied. At the end of the time period T, the output relay energises and remains energised until the supply voltage is removed.

02 Interval



The output relay energises when the supply voltage is applied. At the end of the time period T the relay de-energises.

03 Delayed Cycling with Equal on and Off Time




With the supply voltage applied the output relay is de-energised for the time period T then energises for the same time period T, repeating indefinitely until the supply voltage is removed.

04 Immediate Cycling with Equal On and Off Time




With the supply voltage applied the output relay energises for the time period T then de-energises for the same time period T, repeating indefinitely until the supply voltage is removed.

05 Delayed Pulse (0.5 second)

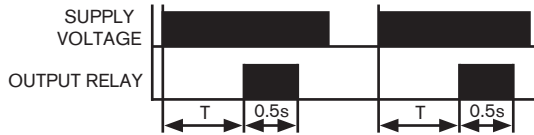


The time period T starts when the supply voltage is applied. At the end of the time period, the output relay energises for 0.5sec before de-energising.

06 Interval (Close to Start)

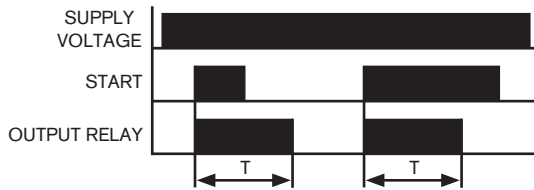


With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). At the end of the time period T the relay de-energises.

07 Interval (Open to Start)

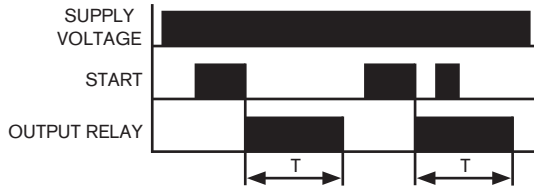


With the supply voltage applied to the timer the output relay energises when the start contacts are opened (falling edge). At the end of the time period T the relay de-energises. During the time period T re-closing and opening the start contacts does not effect the timer output.

08 Delay On Delay Off

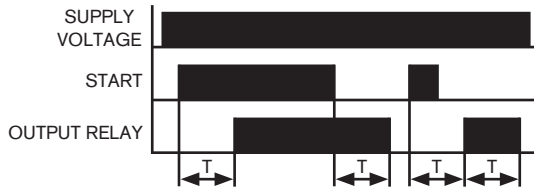


With the supply voltage applied to the timer the time period T starts when the start contacts are closed (rising edge). At the end of the time period T the relay energises. Once the start contacts are then opened (falling edge) the time period T restarts and at the end of the time period T the output relay de-energises. If the start impulse is shorter than the time period T the output is energised for the time period T only.

09 Bistable with Time Limit

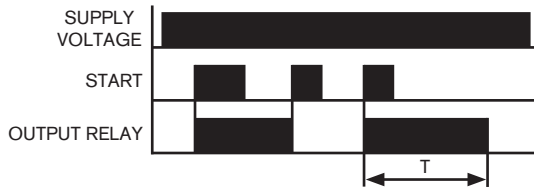


With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). The output relay de-energises when the start contacts are closed again (rising edge) or when the time period T passes. The length of the start impulse is not critical.

10 Delay on De-Energise (Re-triggerable)

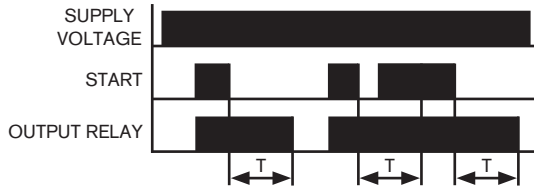


With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). When the start contacts are opened the timing starts and at the end of the time period T the relay de-energises. If the start contacts are closed again before the time period T has elapsed the output will remain energised. Once the start contacts are opened again and time period T elapses the output relay will de-energise.

11 Delay on De-Energise (Non Re-triggerable)

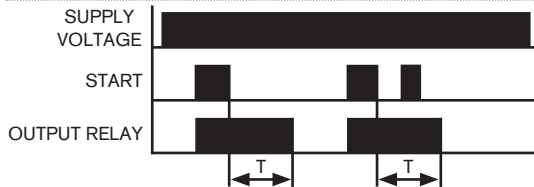

With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). When the start contacts are opened the timing starts and at the end of the time period T the output relay de-energises. If the start contacts are closed again before the time period T has elapsed the output will still de-energise when the time period T elapses.

12 Delay on Energise (Pulse to Start)

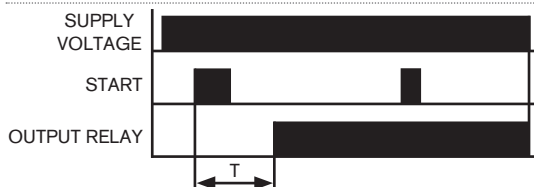

With the supply voltage applied to the timer the time period starts when the start contacts are closed (rising edge). At the end of the time period T, the output relay energises and remains energised until the supply voltage is removed. With the power supply to the timer maintained, re-closing the start contacts has no effect on the output relay.

13 Output Permanently On




With the supply voltage applied to the timer the output relay permanently energises indefinitely until the supply voltage is removed.

14 Output Permanently Off




With the supply voltage applied to the timer the output relay remains permanently de-energised indefinitely.

15 Single Delayed Cycle with Variable On and Off Times

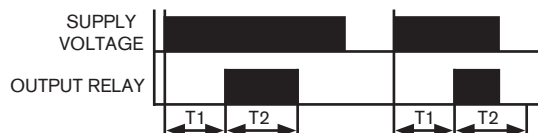


With the supply voltage applied the output relay is de-energised for time period T1 then energises for time period T2. Removing and then reapplying the supply voltage to the timer will restart this timing process.

16 Single Immediate Cycle with Variable On and Off Times

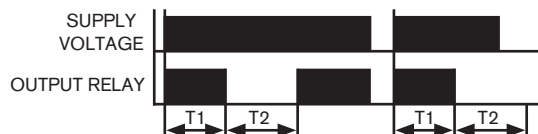

With the supply voltage applied the output relay energises for the time period T1 then de-energises for time period T2 followed by permanently energising until power is removed from the timer. Removing and then reapplying the supply voltage to the timer will restart this timing process.

17 Delayed Cycling with Variable On and Off Times

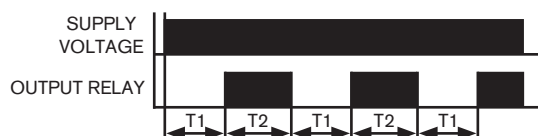


With the supply voltage applied the output relay is de-energised for the time period T1 then energises for time period T2, repeating indefinitely until the supply voltage is removed.

18 Immediate Cycling with Variable On and Off Times




With the supply voltage applied the output relay energises for the time period T1 then de-energises for time period T2, repeating indefinitely until the supply voltage is removed.

19 Delay On Delay Off with Variable Off and On Times (Re-triggerable)

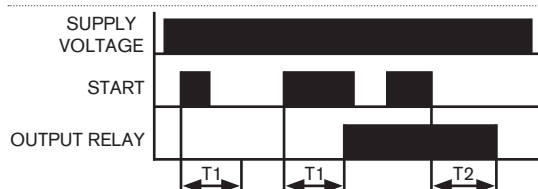


With the supply voltage applied to the timer the time period T1 starts when the start contacts are closed (rising edge). At the end of the time period T1 the relay energises. Once the start contacts are opened (falling edge) the time period T2 starts and at the end of the time period T2 the output relay de-energises. If the start impulse is shorter than the time period T1 the output will not energise.

20 Delay On Delay Off with Variable Off and On Times (Non Re-triggerable)

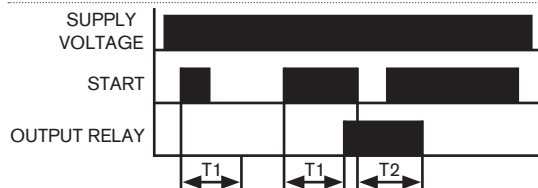


With the supply voltage applied to the timer the time period T1 starts when the start contacts are closed (rising edge) and after time T1 the output relay energises. Opening the start contacts (falling edge) starts time period T2 then after T2 the output relay de-energises. If the start impulse is shorter than the time period T1 the output will not energise. Re-closing the start contacts when the output relay is energised has no effect on the output relay.

21 Interval with Alternate Time Duration

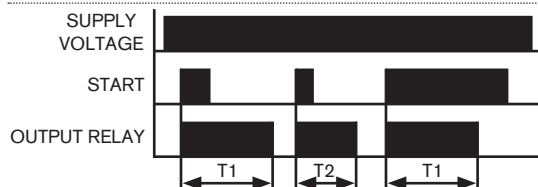

With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). At the end of the time period T1 the relay de-energises. Closing the start contacts again will energise the output relay for time period T2 then the output relay de-energises. A further close of the start contacts will energise the output relay for time period T1 and so on. The length of the start impulse is not critical.

22 Delay Off Delay On

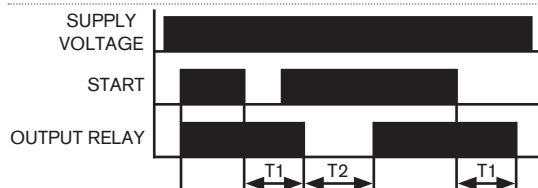


With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). When the start contacts are opened the timing starts and at the end of the time period T1 the output relay de-energises for time period T2. During this T2 period the output relay will not energise. After the T2 period passes if the start contacts are closed the output relay will energise again and the process restarts.

23 Delay On Energise followed by Independent Interval



With the supply voltage applied to the timer the time period T1 starts when the start contacts are closed (rising edge). At the end of the time period T1, if the start contacts are still closed, the output relay energises for time period T2. If the start impulse is shorter than the time period T1 the output will not energise. Re-closing the start contacts when the output relay is energised has no effect on the output relay.

24 Interval followed by Independent Delay on De-Energise

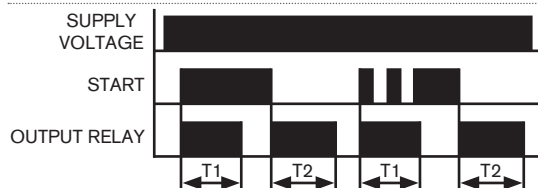

With the supply voltage applied to the timer the output relay energises when the start contacts are closed (rising edge). At the end of the time period T1 the relay de-energises. Once the start contacts are opened (falling edge) the output relay energises again for time period T2 and at the end of the time period T2 the output relay de-energises. Re-closing the start contacts when the output relay is energised has no effect on the output relay.

WARRANTY/DISCLAIMER

OMEGA ENGINEERING, INC. warrants this unit to be free of defects in materials and workmanship for a period of **13 months** from date of purchase. OMEGA's WARRANTY adds an additional one (1) month grace period to the normal **one (1) year product warranty** to cover handling and shipping time. This ensures that OMEGA's customers receive maximum coverage on each product.

If the unit malfunctions, it must be returned to the factory for evaluation. OMEGA's Customer Service Department will issue an Authorized Return (AR) number immediately upon phone or written request. Upon examination by OMEGA, if the unit is found to be defective, it will be repaired or replaced at no charge. OMEGA's WARRANTY does not apply to defects resulting from any action of the purchaser, including but not limited to mishandling, improper interfacing, operation outside of design limits, improper repair, or unauthorized modification. This WARRANTY is VOID if the unit shows evidence of having been tampered with or shows evidence of having been damaged as a result of excessive corrosion; or current, heat, moisture or vibration; improper specification; misapplication; misuse or other operating conditions outside of OMEGA's control. Components in which wear is not warranted, include but are not limited to contact points, fuses, and triacs.

OMEGA is pleased to offer suggestions on the use of its various products. However, OMEGA neither assumes responsibility for any omissions or errors nor assumes liability for any damages that result from the use of its products in accordance with information provided by OMEGA, either verbal or written. OMEGA warrants only that the parts manufactured by the company will be as specified and free of defects. OMEGA MAKES NO OTHER WARRANTIES OR REPRESENTATIONS OF ANY KIND WHATSOEVER, EXPRESSED OR IMPLIED, EXCEPT THAT OF TITLE, AND ALL IMPLIED WARRANTIES INCLUDING ANY WARRANTY OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED. LIMITATION OF LIABILITY: The remedies of purchaser set forth herein are exclusive, and the total liability of OMEGA with respect to this order, whether based on contract, warranty, negligence, indemnification, strict liability or otherwise, shall not exceed the purchase price of the component upon which liability is based. In no event shall OMEGA be liable for consequential, incidental or special damages.

CONDITIONS: Equipment sold by OMEGA is not intended to be used, nor shall it be used: (1) as a "Basic Component" under 10 CFR 21 (NRC), used in or with any nuclear installation or activity; or (2) in medical applications or used on humans. Should any Product(s) be used in or with any nuclear installation or activity, medical application, used on humans, or misused in any way, OMEGA assumes no responsibility as set forth in our basic WARRANTY/DISCLAIMER language, and, additionally, purchaser will indemnify OMEGA and hold OMEGA harmless from any liability or damage whatsoever arising out of the use of the Product(s) in such a manner.

RETURN REQUESTS/INQUIRIES

Direct all warranty and repair requests/inquiries to the OMEGA Customer Service Department. BEFORE RETURNING ANY PRODUCT(S) TO OMEGA, PURCHASER MUST OBTAIN AN AUTHORIZED RETURN (AR) NUMBER FROM OMEGA'S CUSTOMER SERVICE DEPARTMENT (IN ORDER TO AVOID PROCESSING DELAYS). The assigned AR number should then be marked on the outside of the return package and on any correspondence.

The purchaser is responsible for shipping charges, freight, insurance and proper packaging to prevent breakage in transit.

FOR **WARRANTY** RETURNS, please have the following information available BEFORE contacting OMEGA:

1. Purchase Order number under which the product was PURCHASED,
2. Model and serial number of the product under warranty, and
3. Repair instructions and/or specific problems relative to the product.

FOR **NON-WARRANTY** REPAIRS, consult OMEGA for current repair charges. Have the following information available BEFORE contacting OMEGA:

1. Purchase Order number to cover the COST of the repair,
2. Model and serial number of the product, and
3. Repair instructions and/or specific problems relative to the product.

OMEGA's policy is to make running changes, not model changes, whenever an improvement is possible. This affords our customers the latest in technology and engineering.

OMEGA is a trademark of OMEGA ENGINEERING, INC.

© Copyright 2019 OMEGA ENGINEERING, INC. All rights reserved. This document may not be copied, photocopied, reproduced, translated, or reduced to any electronic medium or machine-readable form, in whole or in part, without the prior written consent of OMEGA ENGINEERING, INC.

Where Do I Find Everything I Need for Process Measurement and Control? **OMEGA...Of Course!** *Shop online at omega.com*

TEMPERATURE

- ☑ Thermocouple, RTD & Thermistor Probes, Connectors, Panels & Assemblies
- ☑ Wire: Thermocouple, RTD & Thermistor
- ☑ Calibrators & Ice Point References
- ☑ Recorders, Controllers & Process Monitors
- ☑ Infrared Pyrometers

PRESSURE, STRAIN AND FORCE

- ☑ Transducers & Strain Gages
- ☑ Load Cells & Pressure Gages
- ☑ Displacement Transducers
- ☑ Instrumentation & Accessories

FLOW/LEVEL

- ☑ Rotameters, Gas Mass Flowmeters & Flow Computers
- ☑ Air Velocity Indicators
- ☑ Turbine/Paddlewheel Systems
- ☑ Totalizers & Batch Controllers

pH/CONDUCTIVITY

- ☑ pH Electrodes, Testers & Accessories
- ☑ Benchtop/Laboratory Meters
- ☑ Controllers, Calibrators, Simulators & Pumps
- ☑ Industrial pH & Conductivity Equipment

DATA ACQUISITION

- ☑ Communications-Based Acquisition Systems
- ☑ Data Logging Systems
- ☑ Wireless Sensors, Transmitters, & Receivers
- ☑ Signal Conditioners
- ☑ Data Acquisition Software

HEATERS

- ☑ Heating Cable
- ☑ Cartridge & Strip Heaters
- ☑ Immersion & Band Heaters
- ☑ Flexible Heaters
- ☑ Laboratory Heaters

ENVIRONMENTAL MONITORING AND CONTROL

- ☑ Metering & Control Instrumentation
- ☑ Refractometers
- ☑ Pumps & Tubing
- ☑ Air, Soil & Water Monitors
- ☑ Industrial Water & Wastewater Treatment
- ☑ pH, Conductivity & Dissolved Oxygen Instruments