


DMD1080, DMD1080-DC DC Input Alarm Trips

M-5245/1114



User's Guide

Model	Module Power
DMD1080	85-265 VAC, 50/60 Hz or 60-300 VDC
DMD1080-DC	9-30 VDC or 10-32 VAC

Description

The DMD1080 accepts a DC voltage or current input and provide visual alarm indication and alarm relay contact outputs. 15 voltage and 9 current input ranges can be field-configured via external rotary and slide switches. Offset ranges such as 1-5 VDC and 4-20 mA DC are also included.

Heavy-duty relay contacts allow the module to directly control high capacity loads. Front-accessible potentiometers are used to adjust the alarm setpoint from 0 to 100% and the deadband from 1 to 100%.

The DMD1080 provides a single setpoint adjustment of the two DPST relay contacts. The alarm output can be field configured for HI or LO operation, latching or non-latching, and normal or reverse acting. Deadband control can be adjusted from 1 to 100% and the alarm setpoint from 0 to 100%.

Sink/Source Input and Loop Supply

For maximum versatility, a current input can be selectively wired for sinking or sourcing. This allows the DMD1080 to work with powered or unpowered mA inputs. A regulated 15 VDC loop excitation supply can be used to power passive input devices eliminating the need for an additional DC loop supply.

Input and Alarm Status LEDs

The input LED varies in intensity with changes in the process input signal. A red/green bi-color alarm status LED visually indicate alarm status. These LEDs provide a quick visual status of your process at all times.

Output Test / Unlatch

A functional test button can be used to verify the alarm and system operation and also provides the additional function of unlatching the alarm when the latching mode has been selected. The output test button greatly aids in saving time during initial startup and/or troubleshooting.

Input Ranges

24 field selectable ranges via switch settings

See chart on next page

Voltage: 0-50 mVDC to 0-10 VDC

Bipolar Voltage: ± 5 VDC or ± 10 VDC

Current: 0-1 mA DC to 0-20 mA DC, 4-20 mA DC

Input Impedance and Burden

Voltage: 250 k Ω minimum

Current: 50 Ω typical

Voltage burden: 1 VDC at 20 mA current input

Isolation

1200 V isolation: power to input

600 VAC_p or 600 VDC common mode protection

Input Loop Power Supply

15 VDC $\pm 10\%$, regulated, 25 mA DC

Max. ripple, less than 10 mV_{rms}

May be selectively wired for sinking or sourcing mA input

LED Indicators

Variable brightness LED indicates input level and status

Bi-color red/green alarm LED indicates alarm status

Setpoint

12 turn potentiometer adjustable from 0 to 100% of span

Deadband

12 turn potentiometer adjustable from 1 to 100% of span

Response Time

70 milliseconds typical



Relay Output

Single setpoint dual DPST contact sets, field configurable
2 Form A (NO) and 2 Form B (NC) contact sets (8 terminals)
May be field wired for Form C operation

Relay Configurations

Switch selectable, any combination of

HI or LO

Latching or non-latching

Normal or reverse acting

Relay Contact Ratings

8 A @ 240 VAC resistive load


5 A @ 240 VAC inductive load ($\cos \phi = 0.4$)

8 A @ 30 VDC resistive load

3.5 A @ 30 VDC inductive load ($L/R = 7$ ms)

An RC snubber is recommended for inductive loads

Relay Contact Ratings



Shop online at

omega.com

Ω OMEGA®

omega.com

e-mail: info@omega.com

For latest product manuals:

omegamanual.info

ISO 9001
CERTIFIED
CORPORATE QUALITY

STAMFORD, CT

ISO 9002
CERTIFIED
CORPORATE QUALITY

MANCHESTER, UK

1 YEAR
WARRANTY

MADE IN
USA

Functional Test/Reset Button

Toggles relay to opposite state when pressed

Resets latching relay if latching relay mode is selected

Ambient Temperature Range and Stability

-10°C to +60°C operating ambient

Better than 1% of span over operating temperature range

Better than 0.02% of span per °C

Power

85-265 VAC, 50/60 Hz or 60-300 VDC, 2 W maximum

DC version: 9-30 VDC or 10-32 VAC 50/60 Hz, 2 W maximum

Housing

Mounts to standard 35 mm DIN rail

IP 40

Connectors

Four 4-terminal removable connectors

14 AWG max wire size

Dimensions

0.89" W x 4.62" H x 4.81" D

(22.5 x 117 x 122 mm)

Height includes connectors

Range Selection

It is generally easier to select ranges before installation. See the model/serial number label for module information, options, or if a custom range was specified.

Set input selector switch A to "I" for a current input or to "V" for a voltage input.

Switch settings B and C determine the input range.

Switch D determines the alarm configuration.

Input Configuration Settings		
Input Range	Switch A	Switch B C
0-50 mV	V	8 1
0-100 mV	V	9 1
0-200 mV	V	A 1
0-250 mV	V	C 1
0-400 mV	V	B 1
0-500 mV	V	0 1
0-1 V	V	1 1
0-2 V	V	2 1
0-2.5 V	V	4 1
0-4 V	V	3 1
1-5 V	V	3 F
0-5 V	V	5 1
0-10 V	V	6 1
±5 V	V	6 1
±10 V	V	7 4
0-1 mA	I	C 4
0-2 mA	I	0 1
0-4 mA	I	1 1
0-8 mA	I	2 1
2-10 mA	I	2 F
0-10 mA	I	4 1
0-16 mA	I	3 1
4-20 mA	I	3 F
0-20 mA	I	5 1

Alarm Configuration Settings			
Alarm Type	Latch	Action	Switch D
HI	No	Normal	2
HI	No	Reverse	6
HI	Yes	Normal	0
HI	Yes	Reverse	4
LO	No	Normal	3
LO	No	Reverse	7
LO	Yes	Normal	1
LO	Yes	Reverse	5

Electrical Connections

WARNING! All wiring must be performed by a qualified electrician or instrumentation engineer. See diagrams for terminal designations and wiring examples.

Avoid shock hazards! Turn power off to signal input, relay wiring, and module power before connecting or disconnecting wiring.

Module Power Terminals

Check white model/serial number label for module operating voltage to make sure it matches available power.

When using DC power, either polarity is acceptable, but for consistency with similar products, positive (+) can be wired to terminal 13 and negative (-) can be wired to terminal 16.

Signal Input Terminals

Polarity must be observed for input wiring connections. If the input does not function, check switch settings and wiring polarity.

Voltage inputs are connected as shown in the table below.

The input can be used with either sinking or sourcing milliamp devices. Only one device must provide power to the current loop. For a transmitter with a current output, determine if it provides power to the current loop or if it must be powered by the DMD 1080 module. Use a multi-meter to check for voltage at the transmitter's output terminals. Typical voltage may be in the range of 9 to 24 VDC. In this case, wire the device to terminals 9 and 11.

Type of Input Device	- Terminal	+ Terminal
Sensor or transmitter with a voltage output.	9 (-)	11 (+)
Transmitter with a mA (current) output that provides power to the current loop. Typically a 3 or 4-wire device.	9 (-)	11 (+)
Transmitter with mA (current) output that is unpowered. Typically a 2-wire device. DMD module provides loop power.	11 (-) Signal	10 (+15 V)

Relay Output Terminals

See wiring diagrams for connections. The module does not provide power to the relay contacts.

Inductive loads (motors, solenoids, contactors, etc.) will greatly shorten relay contact life unless an appropriate RC snubber is installed.


The DMD1080 operates two sets of relays in unison with a single setpoint. The dual DPST contact sets are in a Form A (NO) and a Form B (NC) configuration.

They may be field wired for Form C operation as required.

Jumper 2 & 3 for Form C operation

Relay Outputs
Single setpoint
dual DPST

Jumper 6 & 7 for Form C operation



Test: Push to toggle relays to opposite state


Input LED: Variable brightness green LED indicates input level

Bi-Color Alarm LED


Green = non-alarm condition
Red = alarm condition

Deadband: Smaller = counterclockwise. Symmetrical about setpoint


Setpoint: Higher = clockwise

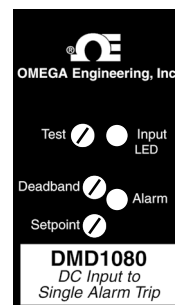


Current Sourcing Input
DMD1080 provides power to input loop. Typical when using a passive or unpowered transmitter or sensor.





Current Sinking Input
Typical of a system using a transmitter that is externally powered and provides power to the loop.



Current Sinking Input with Separate Power Supply
Typical of a system using a passive transmitter and a loop power supply to power to the loop.



Voltage Input
Typical of a system using a transmitter that has a voltage output.

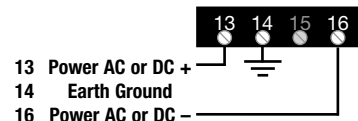

DMD1080: 85-265 VAC, 50/60 Hz or 60-300 VDC

DMD1080-DC: 9-30 VDC or 10-32 VAC 50/60 Hz

Mounting

The housing clips to a standard 35 mm DIN rail. The housing is IP40 rated and should be mounted inside a panel or enclosure. See illustration below.

Precautions


WARNING! Avoid shock hazards! Turn signal input, output, and power off before connecting or disconnecting wiring, or removing or installing module.

Installation

1. Tilt front of module downward and position the lower mounts and spring clips against the bottom edge of DIN rail.
2. Clip Lower Mount to bottom edge of DIN rail.
3. Push front of module upward until upper mount snaps into place.

Removal

1. Push up on bottom back of module.
2. Tilt front of module downward to release upper mount from top edge of DIN rail.
3. The module can now be removed from the DIN rail.

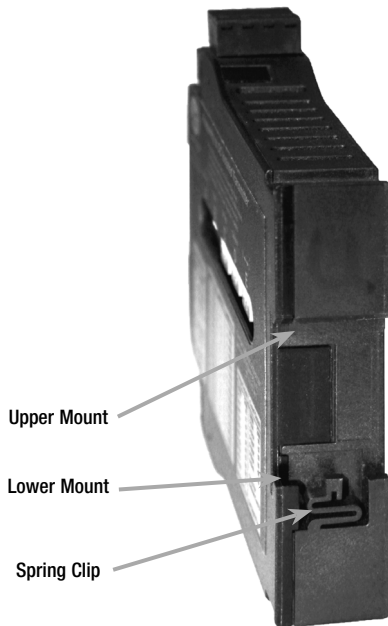

Setup and Calibration

The input ranges are factory calibrated and do not require adjustment.

The Setpoint potentiometer allows the operator to adjust the level at which the alarm is activated. This control is adjustable from 0 to 100% of the input range.

The Deadband potentiometer allows the alarm trip and reset window to be adjusted symmetrically about the setpoint from 1 to 100% of the span. This allows the operator to fine tune the point at which the alarm trips and resets.

The deadband is typically used to prevent chattering of the relays or false trips when the process signal is unstable or changes rapidly.

To calibrate the alarm section, set the deadband control to the minimum (counterclockwise).

Set the signal source to a reference that represents the desired trip point.

Adjust the setpoint control to the point at which the relay changes state from a non-alarm to an alarm condition. The deadband will be 1.0% of span in this case.

If a larger amount of deadband is desired turn the deadband potentiometer clockwise. The deadband is symmetrical about the setpoint; both transition points will change as deadband is increased.

Output Test Function

When the test button is depressed it will drive the relays to their opposite state. This can be used as a diagnostic aid during initial start-up or troubleshooting. When released, the relays will return to their prior states.

Operation

The green input LED provides a visual indication that a signal is being sensed by the input circuitry of the module. It also indicates the input signal strength by changing in intensity as the process changes from minimum to maximum.

If the LED fails to illuminate, or fails to change in intensity as the process changes, check the module power or signal input wiring. Note that it may be difficult to see the LEDs under bright lighting conditions.

The bi-color alarm LED provides a visual indication of the alarm status. In all configurations, a green LED indicates a non-alarm condition and a red LED indicates an alarm condition.

In the normal mode of operation, the relay coil is energized in a non-alarm condition and de-energized in an alarm condition. This will create an alarm condition if the module loses power.

For a normal acting, non-latching configuration, the alarm will activate when the input signal exceeds the setpoint (HI alarm) or falls below the setpoint (LO alarm), then will automatically reset when the alarm condition no longer exists.

For a reverse acting alarm, the relay coil is de-energized in a non-alarm condition and energized in an alarm condition. The alarm activates when the input signal exceeds the setpoint (HI alarm) or falls below the setpoint (LO alarm), then automatically resets when the alarm condition no longer exists.

When the latching mode is selected, it will be necessary to push the functional test button or remove power from the module to reset the alarm. The alarm will only reset if the alarm condition no longer exists.

omega.com®**Ω OMEGA®**OMEGAnet® Online Service
www.omega.comInternet e-mail
info@omega.com**Servicing North America:**USA:
ISO 9001 CertifiedOne Omega Drive, Box 4047
Stamford CT 06907-0047
Tel: (203) 359-1660 FAX: (203) 359-7700
e-mail: info@omega.comCanada:976 Bergar
Laval (Quebec) H7L 5A1, Canada
Tel: (514) 856-6928 FAX: (514) 856-6886
e-mail: info@omega.ca**For immediate technical or application assistance:**USA and Canada: Sales Service: 1-800-826-6342 / 1-800-TC-OMEGA®
Customer Service: 1-800-622-2378 / 1-800-622-BEST®
Engineering Service: 1-800-872-9436 / 1-800-USA-WHEN®
TELEX: 996404 EASYLINK: 62968934 CABLE: OMEGAMexico: En Español: (001) 203-359-7803 e-mail: espanol@omega.com
FAX: (001) 203-359-7807 info@omega.com.mx**Servicing Europe:**Benelux:Postbus 8034, 1180 LA Amstelveen, The Netherlands
Tel: +31 (0)20 3472121 FAX: +31 (0)20 6434643
Toll Free in Benelux: 0800 0993344
e-mail: sales@omegaeng.nlCzech Republic:Frystatska 184, 733 01 Karviná, Czech Republic
Tel: +420 (0)59 6311899 FAX: +420 (0)59 6311114
Toll Free: 0800-1-66342 e-mail: info@omegashop.czFrance:11, rue Jacques Cartier, 78280 Guyancourt, France
Tel: +33 (0)1 61 37 2900 FAX: +33 (0)1 30 57 5427
Toll Free in France: 0800 466 342
e-mail: sales@omega.frGermany / Austria:Daimlerstrasse 26, D-75392 Deckenpfronn, Germany
Tel: +49 (0)7056 9398-0 FAX: +49 (0)7056 9398-29
Toll Free in Germany: 0800 639 7678
e-mail: info@omega.deUnited Kingdom:
ISO 9002 CertifiedOne Omega Drive, River Bend Technology Centre
Northbank, Irlam, Manchester
M44 5BD United Kingdom
Tel: +44 (0)161 777 6611
FAX: +44 (0)161 777 6622
Toll Free in United Kingdom: 0800-488-488
e-mail: sales@omega.co.uk

It is the policy of OMEGA to comply with all worldwide safety and EMC/EMI regulations that apply. OMEGA is constantly pursuing certification of its products to the European New Approach Directives. OMEGA will add the CE mark to every appropriate device upon certification.

The information contained in this document is believed to be correct, but OMEGA Engineering, Inc. accepts no liability for any errors it contains, and reserves the right to alter specifications without notice. WARNING: These products are not designed for use in, and should not be used for, human applications.

WARRANTY/DISCLAIMER

OMEGA ENGINEERING, INC. warrants this unit to be free of defects in materials and workmanship for a period of 13 months from date of purchase. OMEGA's WARRANTY adds an additional one (1) month grace period to the normal one (1) year product warranty to cover handling and shipping time. This ensures that OMEGA's customers receive maximum coverage on each product.

If the unit malfunctions, it must be returned to the factory for evaluation. OMEGA's Customer Service Department will issue an Authorized Return (AR) number immediately upon phone or written request. Upon examination by OMEGA, if the unit is found to be defective, it will be repaired or replaced at no charge. OMEGA's WARRANTY does not apply to defects resulting from any action of the purchaser, including but not limited to mishandling, improper interfacing, operation outside of design limits, improper repair, or unauthorized modification. This WARRANTY is VOID if the unit shows evidence of having been tampered with or shows evidence of having been damaged as a result of excessive corrosion; or current, heat, moisture or vibration; improper specification; misapplication; misuse or other operating conditions outside of OMEGA's control. Components which wear are not warranted, including but not limited to contact points, fuses, and triacs.

OMEGA is pleased to offer suggestions on the use of its various products. However, OMEGA neither assumes responsibility for any omissions or errors nor assumes liability for any damages that result from the use of its products in accordance with information provided by OMEGA, either verbal or written. OMEGA warrants only that the parts manufactured by it will be as specified and free of defects. OMEGA MAKES NO OTHER WARRANTIES OR REPRESENTATIONS OF ANY KIND WHATSOEVER, EXPRESS OR IMPLIED, EXCEPT THAT OF TITLE, AND ALL IMPLIED WARRANTIES INCLUDING ANY WARRANTY OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED. LIMITATION OF LIABILITY: The remedies of purchaser set forth herein are exclusive, and the total liability of OMEGA with respect to this order, whether based on contract, warranty, negligence, indemnification, strict liability or otherwise, shall not exceed the purchase price of the component upon which liability is based. In no event shall OMEGA be liable for consequential, incidental or special damages.

CONDITIONS: Equipment sold by OMEGA is not intended to be used, nor shall it be used: (1) as a "Basic Component" under 10 CFR 21 (NRC), used in or with any nuclear installation or activity; or (2) in medical applications or used on humans. Should any Product(s) be used in or with any nuclear installation or activity, medical application, used on humans, or misused in any way, OMEGA assumes no responsibility as set forth in our basic WARRANTY/DISCLAIMER language, and, additionally, purchaser will indemnify OMEGA and hold OMEGA harmless from any liability or damage whatsoever arising out of the use of the Product(s) in such a manner.

RETURN REQUESTS / INQUIRIES

Direct all warranty and repair requests/inquiries to the OMEGA Customer Service Department. BEFORE RETURNING ANY PRODUCT(S) TO OMEGA, PURCHASER MUST OBTAIN AN AUTHORIZED RETURN (AR) NUMBER FROM OMEGA'S CUSTOMER SERVICE DEPARTMENT (IN ORDER TO AVOID PROCESSING DELAYS). The assigned AR number should then be marked on the outside of the return package and on any correspondence.

The purchaser is responsible for shipping charges, freight, insurance and proper packaging to prevent breakage in transit.

PATENT NOTICE: U. S. Pat. No. 6,074,089; 5,465,838 / Canada 2,228,333; 2,116,055 / UK GB 2,321,712 / Holland 1008153 / Israel 123052 / France 2 762 908 / EPO 0614194. Other patents pending.

FOR WARRANTY RETURNS, please have the following information available BEFORE contacting OMEGA:

1. Purchase Order number under which the product was PURCHASED,
2. Model and serial number of the product under warranty, and
3. Repair instructions and/or specific problems relative to the product.

FOR NON-WARRANTY REPAIRS, consult OMEGA for current repair charges. Have the following information available BEFORE contacting OMEGA:

1. Purchase Order number to cover the COST of the repair,
2. Model and serial number of the product, and
3. Repair instructions and/or specific problems relative to the product.

OMEGA's policy is to make running changes, not model changes, whenever an improvement is possible. This affords our customers the latest in technology and engineering.

OMEGA is a registered trademark of OMEGA ENGINEERING, INC.

© Copyright 2004 OMEGA ENGINEERING, INC. All rights reserved. This document may not be copied, photocopied, reproduced, translated, or reduced to any electronic medium or machine-readable form, in whole or in part, without the prior written consent of OMEGA ENGINEERING, INC.

M-5245/1114